

# Water Softener Salt Requirements for Genoa Township Wastewater Systems


Wastewater: Genoa-Oceola Municipal Sewer  
 Water: Private well  
 Sodium based salt ALLOWED.

Wastewater: Lake Edgewood Municipal Sewer  
 Water: Private well or City of Brighton Municipal Water  
 Potassium chloride salt is REQUIRED.

Wastewater: Oak Pointe Municipal Sewer  
 Water: Private well or Oak Pointe Municipal Water  
 Potassium Chloride Salt REQUIRED until construction is completed on the Wastewater treatment plant upgrades. Project completion in February of 2015.

Wastewater: Genoa-Oceola Municipal Sewer  
 Water: MHOG Municipal Water  
 You do not need a water softener. MHOG water is softened at the municipal water treatment plant.

Wastewater: Lake Edgewood Municipal Sewer  
 Water: MHOG Municipal Water  
 You do not need a water softener. MHOG water is softened at the municipal water treatment plant.

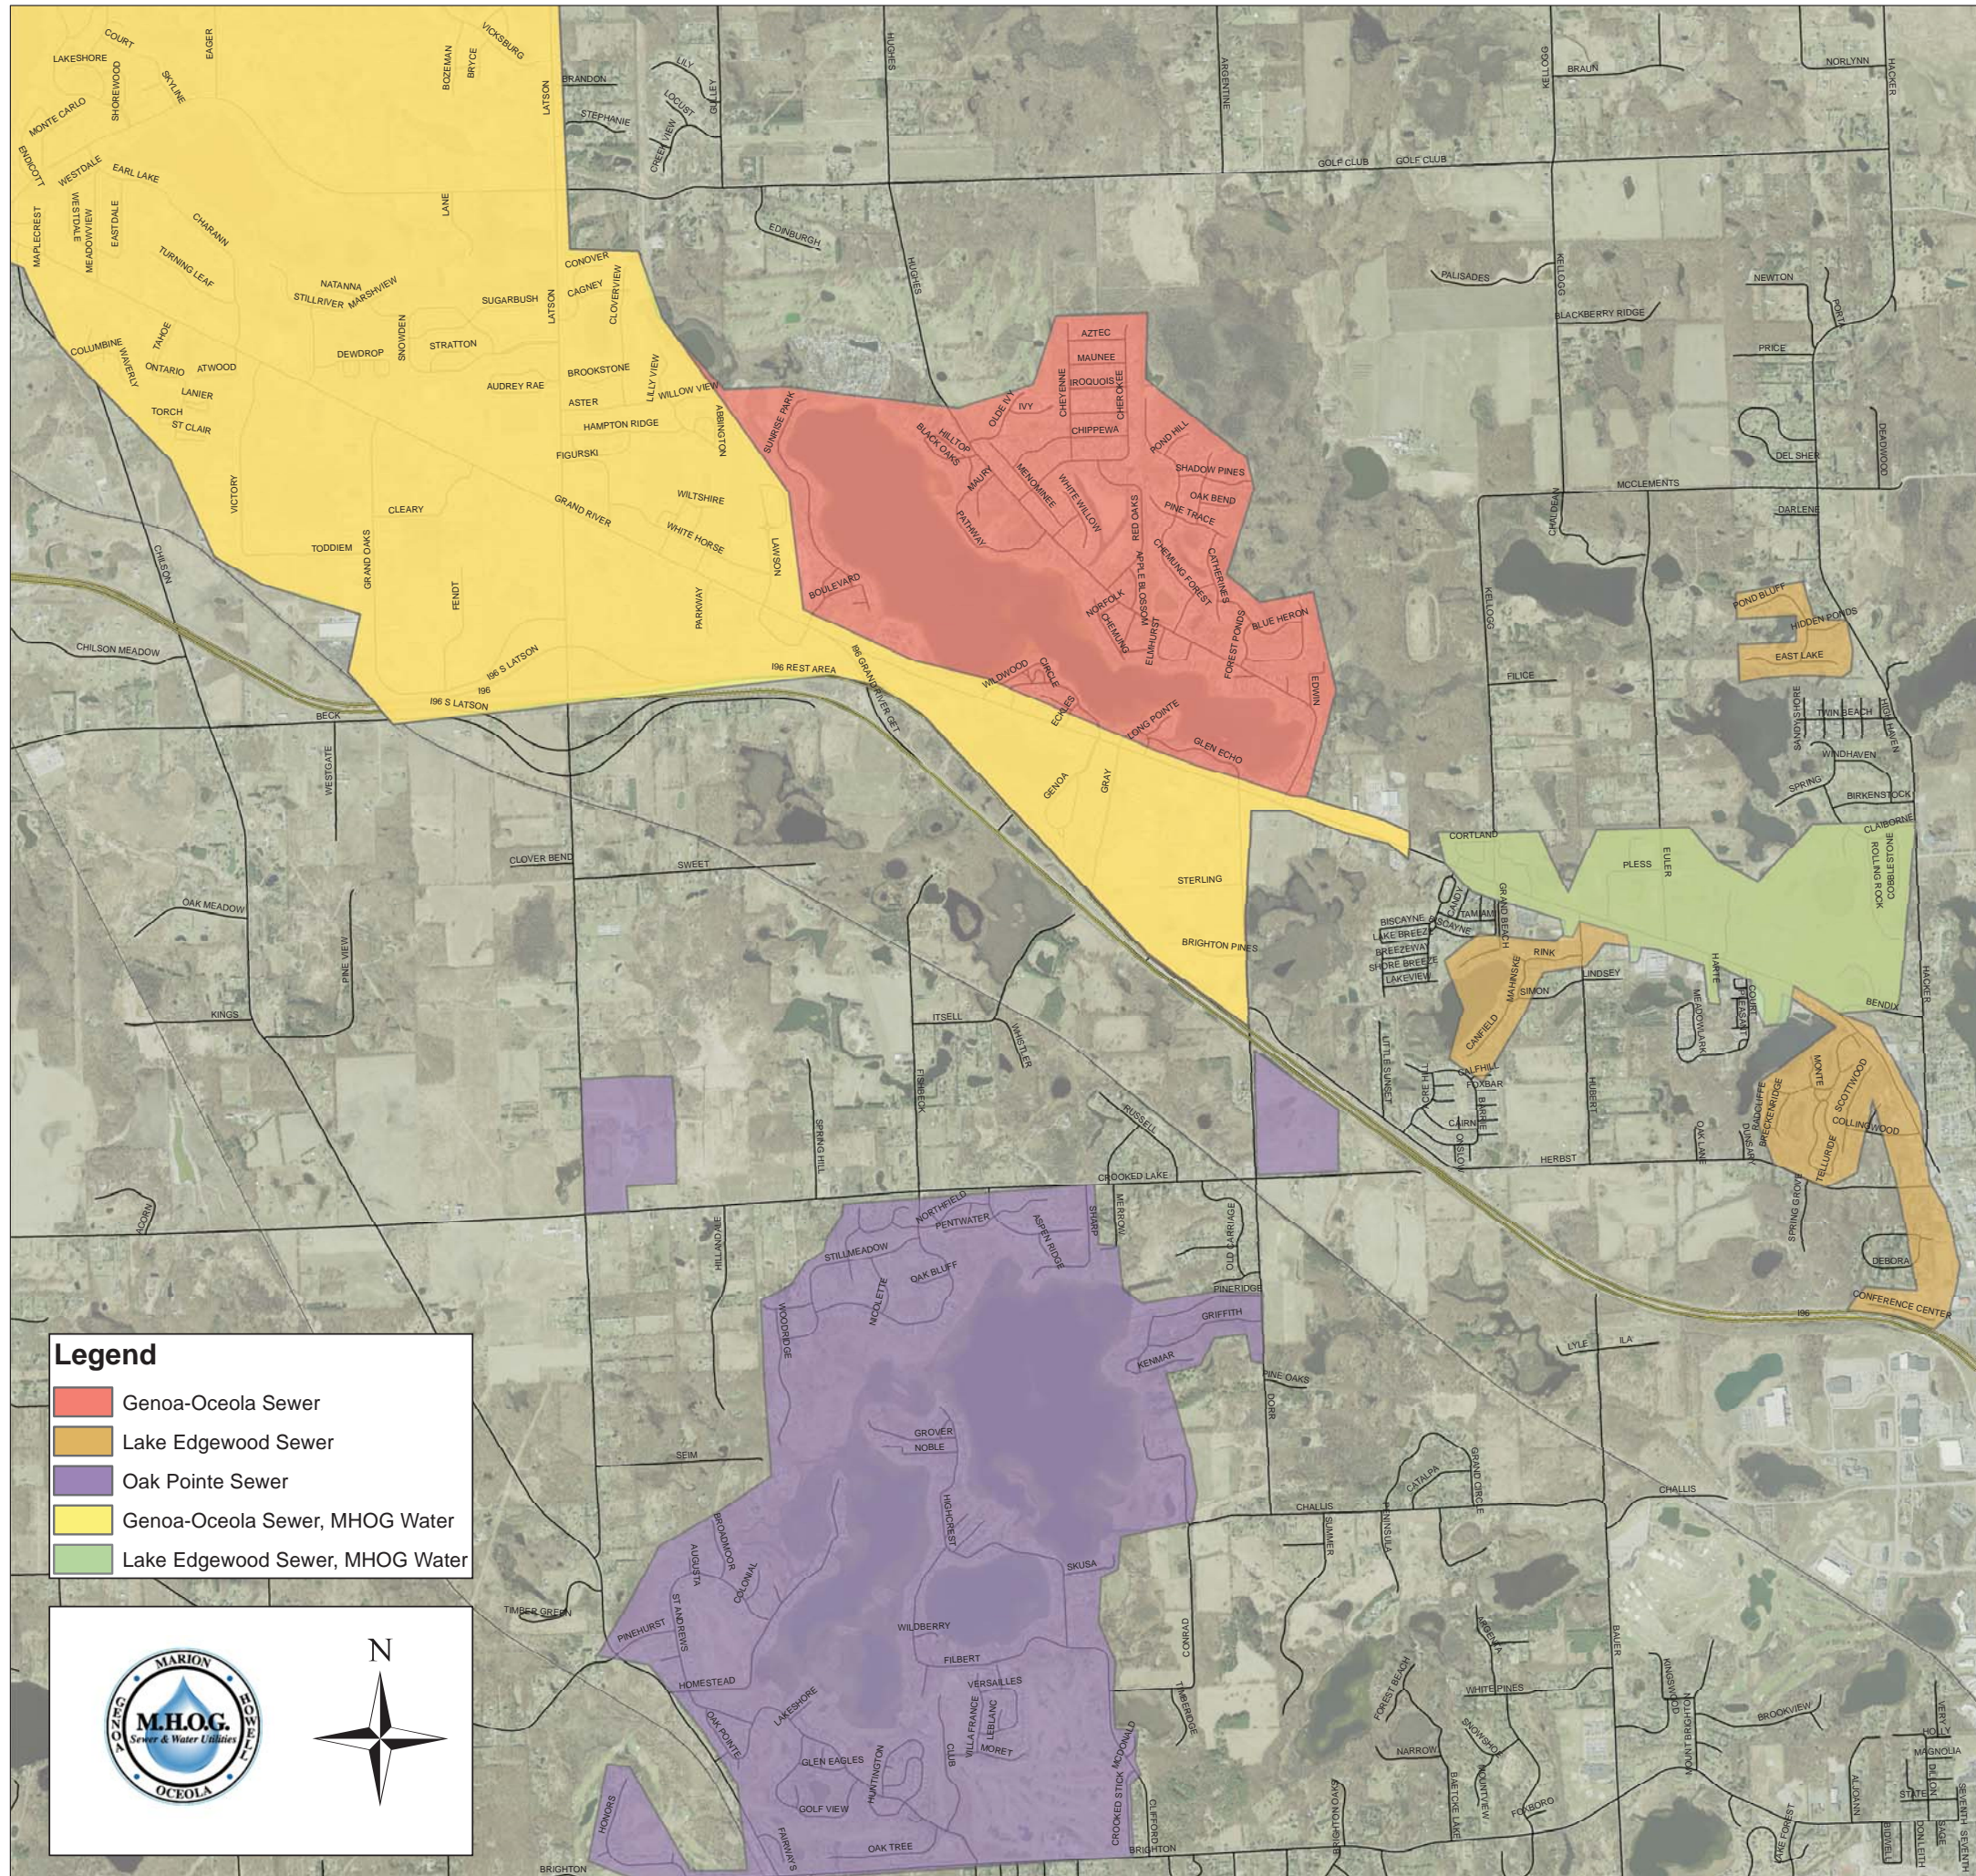

**Note: Boundaries are approximate, please see Township Staff for parcel specific information**

